

# IMPROVEMENT PERMIT

CDP File Number: 413166


County File Number:

Date: 05/23/24

Drawing: Drawing Type: Improvement Permit

Scale: \_\_\_\_\_  Inch = \_\_\_\_\_ ft.  
 Block  
 N/A

- Conv. Initial w/ Casp Repair
  - 3'-7.5" drainliner
  - 18'-24" trench depth
  - 1000 gal Septic tank MIN
  - New well > 50' MIN set back from well and all parts of any septic area
  - 10' set back from all property line
  - 360 opd / 16 pul Max
  - No driveway over Septic area
  - Plants approved for 3 bedrooms for Alexander Reed by Denny Jacobs
- 05/23/24

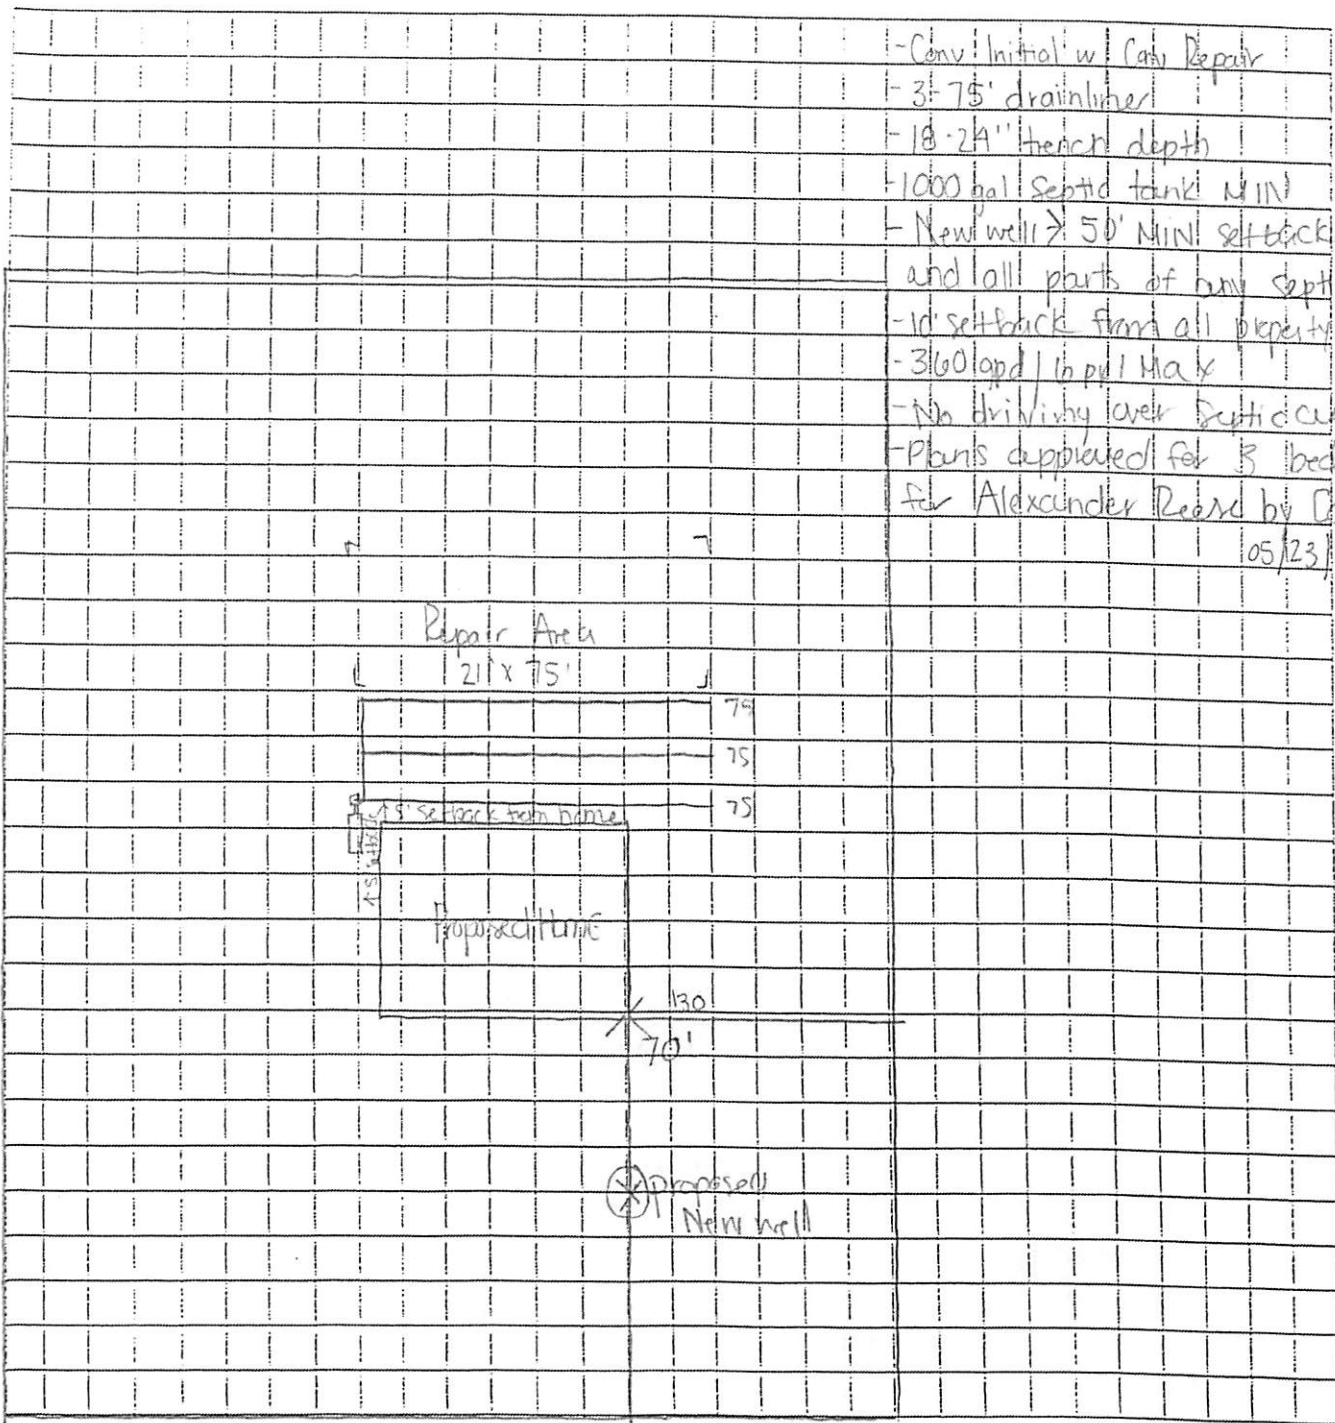

Richland Dr